

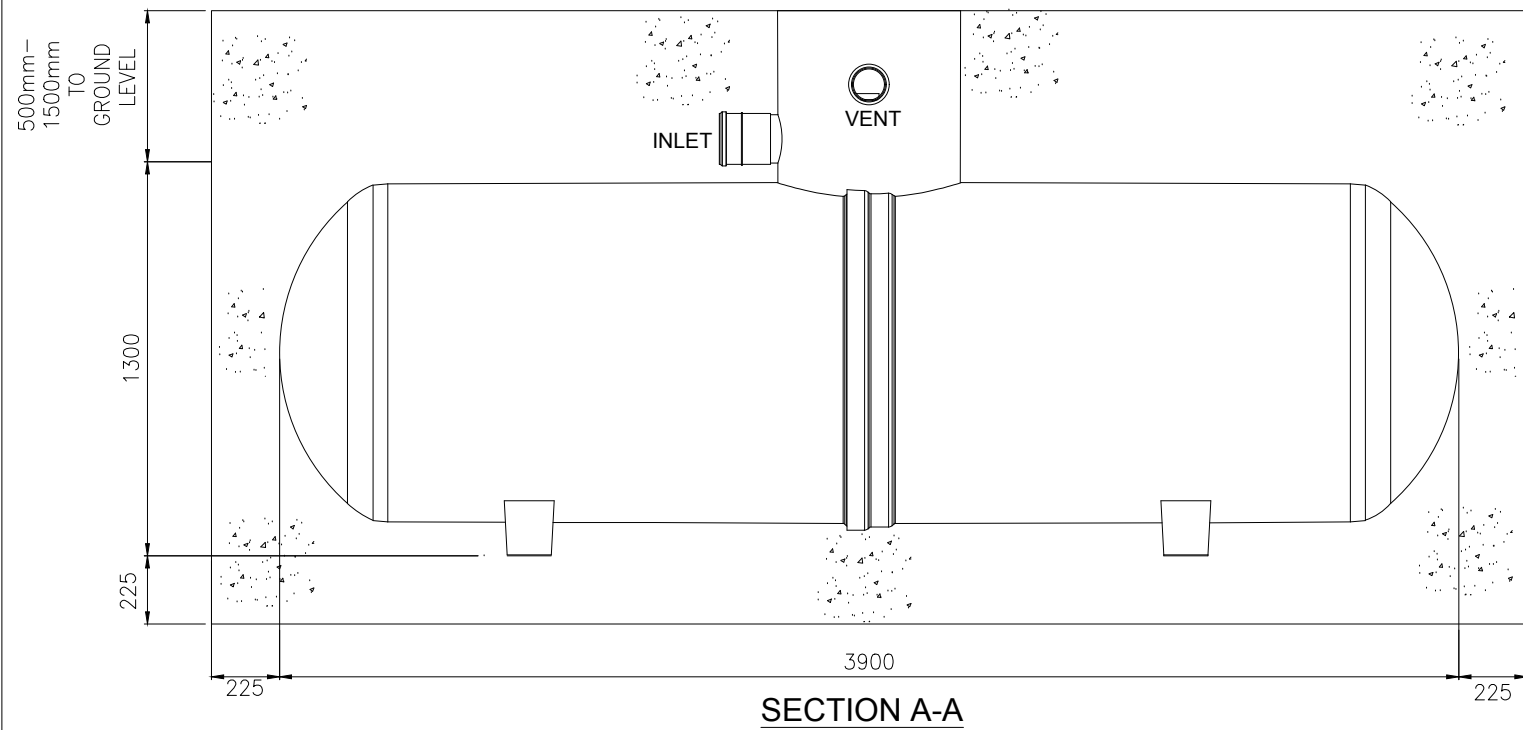
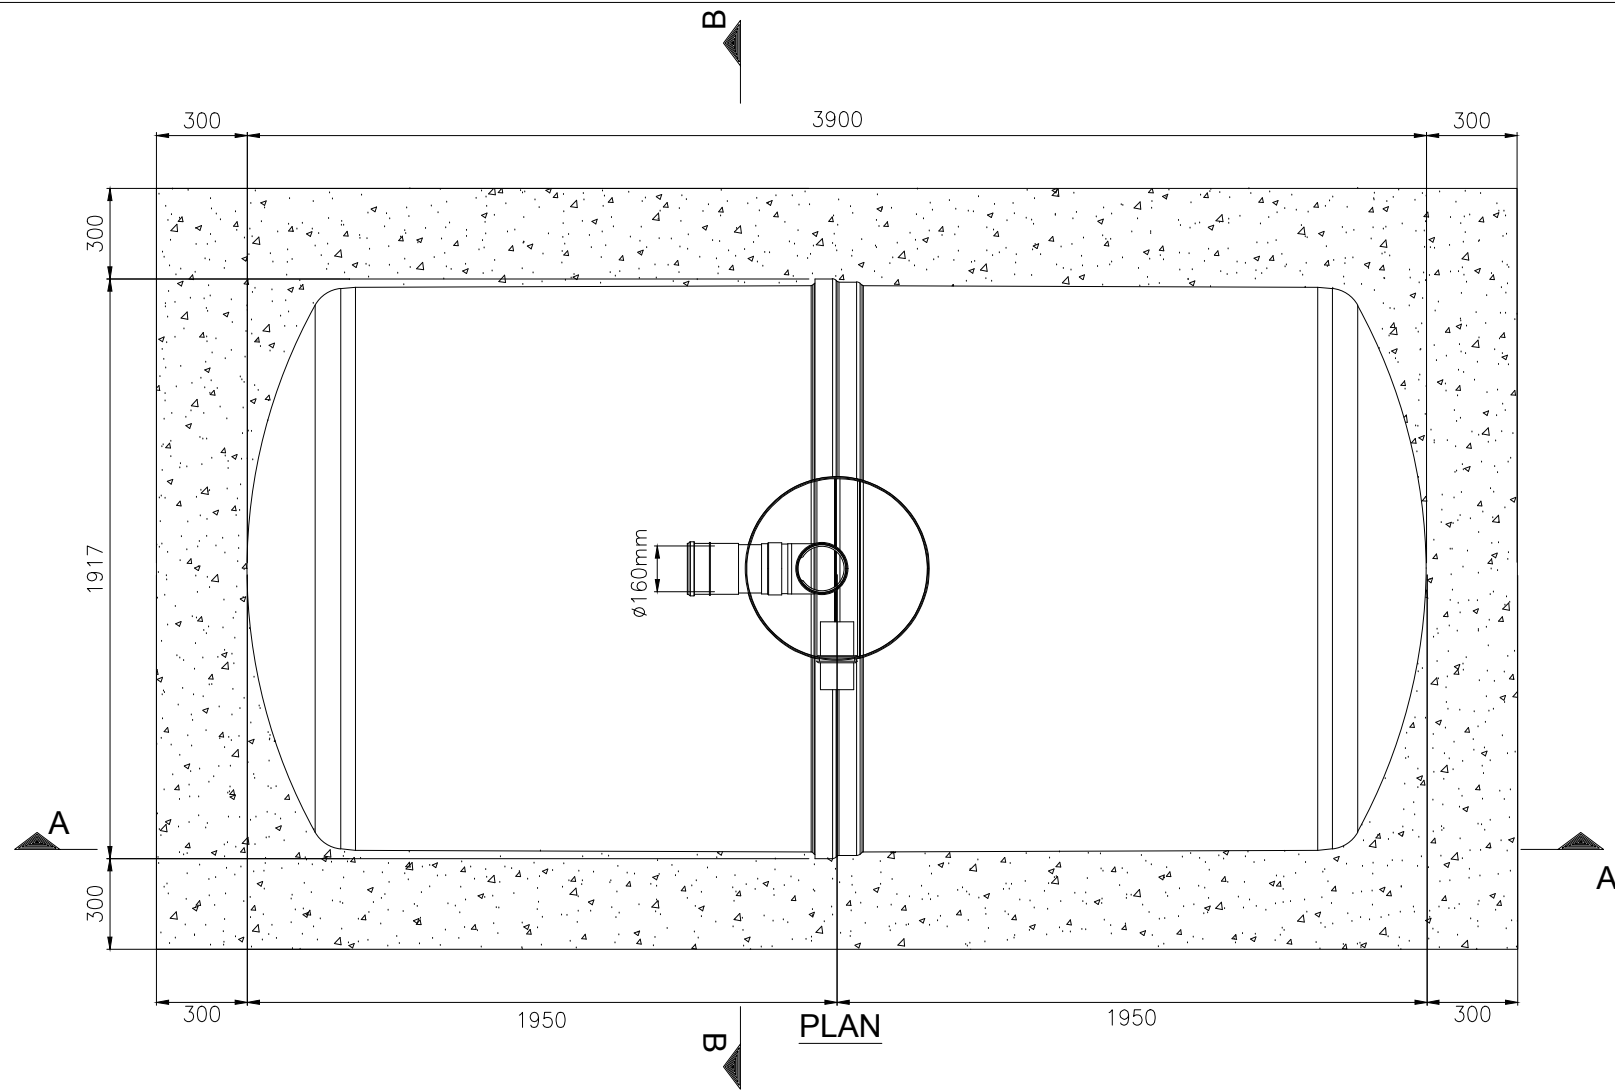


Plotted : on 11th Feb. 2016 at 17:25 by GRAHAM\_MCEWAN  
 File Name : Z:\UK\UKED1\JOBS\PR-330514\_SSE\_PROJECT\_ECHO900\_CAD\_GIS\910\_CADD\DCIDBAN BOARD PLEAN\A-PACKAGE\60581192-0809A FOUL WATER HOLDING TANK

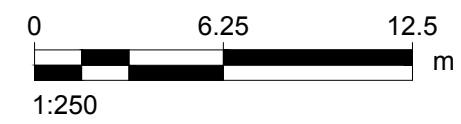

### CESSPOOL TANK NOTES

1. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS STATED OTHERWISE.
2. TANK HAS AN INLET INLET OF 0.5m AS STANDARD. UPON REQUEST TANK MAY BE EXTENDED UP TO 1.5m VIA NECK GRP RISER PIECES.
3. TANK TO BE INSTALLED IN FULL ACCORDANCE WITH MANUFACTURERS SPECIFICATION AND INSTALLATION GUIDE.
4. TANK TO HAVE A MINIMUM OF 225mm CONCRETE SURROUND AROUND THE ENTIRE PERIMETER OF THE TANK AS DETAILED IN LINE WITH MANUFACTURERS RECOMMENDATIONS.
5. CESSPOOL TANK TO BE KINGSPAN CPH038 UNIT OR EQUAL APPROVED.
6. TANK TO BE FITTED WITH HIGH LEVEL ALARM LINKED TO THE CONTROL BUILDING AND BMS IN ACCORDANCE WITH MANUFACTURERS SPECIFICATION AND INSTALLATION GUIDE.
7. SEATING SLAB TO EXTEND 300mm HORIZONTALLY BEYOND TANK IN ALL DIRECTIONS IN LINE WITH MANUFACTURERS RECOMMENDATIONS.
8. REFER TO DRAWING 60581192/0808 FOR PROPOSED TANK LOCATION.

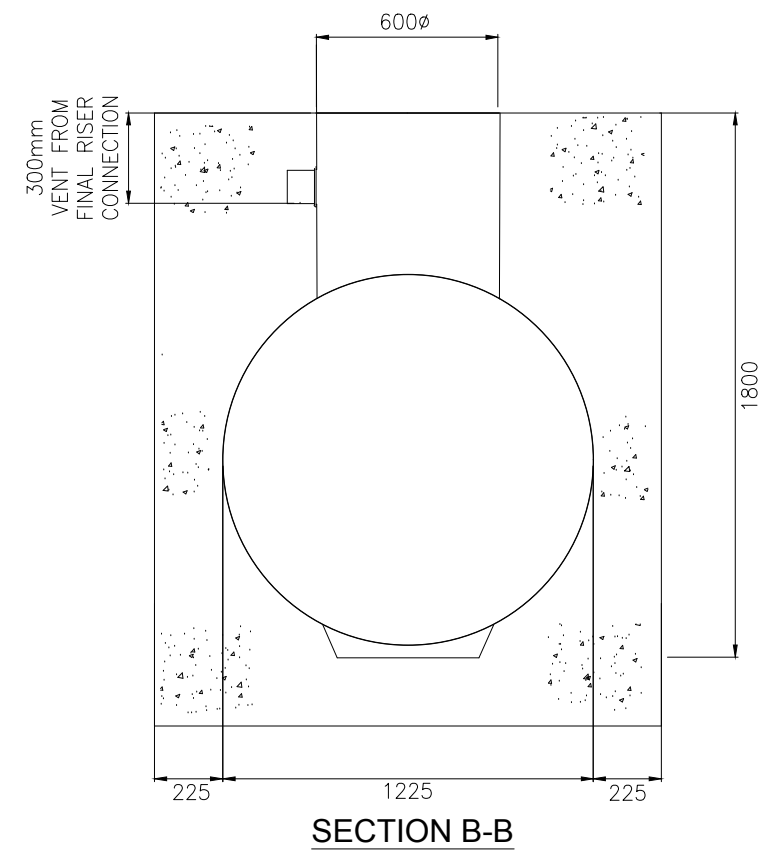

CONSTRUCTION RISKS	MAINTENANCE / CLEANING RISK	DEMOLITION RISKS										
<p>In addition to the hazard/risks normally associated with the types of work detailed on this drawing take note of above.          It is assumed that all works on this drawing will be carried out by a competent contractor working, where appropriate, to an appropriate method statement.</p>												
SAFETY, HEALTH AND ENVIRONMENTAL INFORMATION BOX												
<p>This drawing is for preliminary purposes only and is subject to amendment during design development. UNDER NO CIRCUMSTANCES MUST THIS DRAWING BE USED FOR CONSTRUCTION PURPOSES</p>												
<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 70%;">PROJECT TITLE AND DRAWING TITLE AMENDED</td> <td style="width: 10%;">EP</td> <td style="width: 10%;">CGY</td> <td style="width: 10%;">28.01.19</td> <td style="width: 10%;">A</td> </tr> <tr> <td>Revision Details</td> <td>By</td> <td>Check</td> <td>Date</td> <td>Suffix</td> </tr> </table>			PROJECT TITLE AND DRAWING TITLE AMENDED	EP	CGY	28.01.19	A	Revision Details	By	Check	Date	Suffix
PROJECT TITLE AND DRAWING TITLE AMENDED	EP	CGY	28.01.19	A								
Revision Details	By	Check	Date	Suffix								
<p>Purpose of issue</p> <h2 style="text-align: center;">PLANNING</h2>												
<p>Client</p> <h2 style="text-align: center;">SSE GENERATION IRELAND LTD</h2>												
<p>Project Title</p> <h2 style="text-align: center;">PROPOSED 110kV TRANSMISSION SUBSTATION</h2>												
<p>Drawing Title</p> <h2 style="text-align: center;">PROPOSED UNDERGROUND FOUL HOLDING TANK DETAILS</h2>												
Designed	Drawn	Checked	Approved	Date								
	GMCE	CGY	CGY	DEC'18								
URS Internal Project No.		Suitability										
Scale @ A3		Zone / Mileage										
1:250												
<p>This document has been prepared in accordance with the scope of AECOM's appointment with its client and is subject to the terms of that appointment. AECOM accepts no liability for any use of this document other than by its client and only for the purposes for which it was prepared and provided. Only written dimensions shall be used.          © AECOM</p>												
<p>AECOM          97 HAYMARKET TERRANCE          EDINBURGH          EH12 5HD          TEL 0131-347-1100          FAX 0131-347-1101          www.aecom.com</p>												
<p>Drawing Number</p> <h2 style="text-align: center;">60581192\0809</h2>			<p>Rev</p> <h2 style="text-align: center;">A</h2>									